

Test Report

Report Number:140312001SHJ-BP-1

Applicant Name: Jiangyin Tianhong Decoration Material Co., Ltd. **Original Report Date: April 25, 2014****Applicant Address: 18# Huanxi Road, Huanshi Industrial Zone, Jiangyin city, Jiangsu, China****Attn: Evin Feng****Sample Description:**

Product: Aluminium composite panel

Model: 4 mm

Samples Quantity: 1.5x 1.0(m) 5PCS; 1.5x 0.5(m) 5PCS;
0.5x 0.5(m) 5PCS

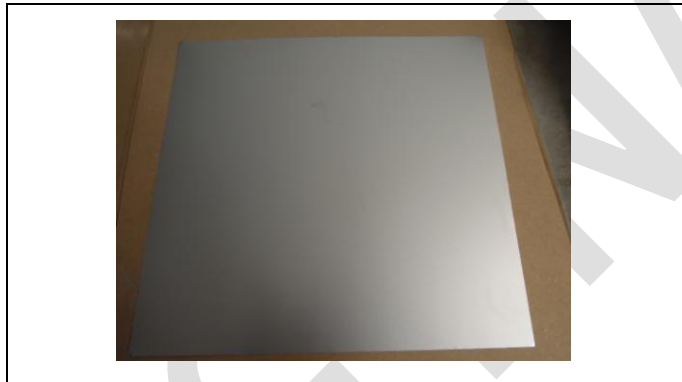
Sample Photos (Received):

Brand: SKY RAINBOW® A2

Sample ID: S140312001SHJ-001

Date Received: April 14, 2014

Date Test Conducted: April 14, 2014~Apr 25, 2014

**Tests Conducted:**

Test Methods: EN 13823:2010, EN ISO 1716:2010, EN 13501-1:2007+A1:2009

Conclusion:

For details refer to attached page(s).

The conclusions of this test report may not be used as part of the requirements for Intertek product certification. Authority to Mark must be issued for a product to become certified.

Should you have any queries about the test report, please contact:

Approved by:**Checked by:****Prepared by:**Sun Sun
SupervisorHarrison Li
Senior Project EngineerHenry Huang
Engineer

Test Items, Method and Results:**1.1 HEAT OF COMBUSTION TEST**

The test was conducted in accordance with EN ISO 1716. In this test, the test specimen of specified mass is burned under standardized conditions, at constant volume, in an atmosphere of oxygen, in a bomb calorimeter. The heat of combustion determined under the specified conditions is calculated on the basis of the observed temperature rise, taking account of heat loss and the latent heat of vaporization of water.

1.2 SINGLE BURNING ITEM TEST

The test was conducted in accordance with EN 13823. This test evaluates the potential contribution of a product to the development of a fire, under a fire situation simulating a single burning item near to the product.

1.3 CLASSIFICATION CRITERIA

The classification was determined in accordance with EN 13501-1: 2007+A1: 2009. The classes A2 with their corresponding fire performance are given in the table below.

Table- Classes of reaction to fire performance for construction products excluding floorings and linear pipe thermal insulation products

Class	Test Method(s)	Classification criteria	Additional classifications
A2	EN ISO 1716 and	PCS \leq 3,0 MJ/Kg ^a and PCS \leq 4,0 MJ/m ² ^b PCS \leq 4,0 MJ/m ² ^c and PCS \leq 3,0 MJ/Kg ^d	-
	EN 13823	FIGRA \leq 120 W/s and LFS < edge of specimen and THR _{600s} \leq 7,5 MJ	Smoke production ^e and Flaming droplets/particles ^f

Note:

- For homogeneous products and substantial components of non-homogeneous products.
- For any external non-substantial component of non-homogeneous products.
- For any internal non-substantial component of non-homogeneous products.
- For the product as a whole.
- In the last phase of the development of the test procedure, modifications of the smoke measurement system have been introduced, the effect of which needs further investigation. This may result in a modification of the limit values and/or parameters for the evaluation of the smoke production.

s1 = SMOGRA \leq 30m²/s² and TSP_{600s} \leq 50m²; s2 = SMOGRA \leq 180m²/s² and TSP_{600s} \leq 200m²; s3 = not s1 or s2

f. d0 = no flaming droplets/ particles in EN 13823 within 600 s;
 d1 = no flaming droplets/ particles persisting longer than 10 s in EN 13823 within 600s;
 d2 = not d0 or d1.
 Ignition of the paper in EN ISO 11925-2 results in a d2 classification.

2 RESULTS AND OBSERATIONS

The test results were shown in Table below.

Method	Parameter		Result
EN ISO 1716	PCS	Facing, MJ/m ²	0.5
		Aluminium Substrate, MJ/kg	0.0
		Adhesive, MJ/m ²	2.2
		Core, MJ/kg	2.6
		Aluminium Substrate, MJ/kg	0.0
		The whole product, MJ/kg	2.0
EN 13823	FIGRA, W/s		0
	THR _{600s} , MJ		0.4
	LFS, m		< Edge of Specimen
	SMOGRA, m ² /s ²		0
	TSP _{600s} , m ²		39
	Flaming Droplets/ Particles		No flaming droplets/ particles occur within 600s

Note:

1. This test was conducted at the external approved facility, located at Guangzhou.
2. The samples were fixed mechanically to a 9mm thick substrate of calcium silicate board. The density of the substrate was 900 kg/m³.

3 CLASSIFICATION

The classification has been carried out in accordance with EN 13501-1.

Fire behaviour		Smoke production			Flaming Droplets	
A2	-	s	1	-	d	0

Reaction to fire classification: *A2-s1, d0*

Appendix:



Fig. 1 Before SBI Test



Fig. 2 Before SBI Test



Fig. 3 After SBI Test



Fig. 4 After SBI Test

The End of Report

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.